



**INSTYTUT TECHNIKI BUDOWLANEJ**  
PL 00-611 WARSZAWA  
ul. Filtrowa 1  
tel.: (+48 22) 825-04-71  
(+48 22) 825-76-55  
fax: (+48 22) 825-52-86  
[www.itb.pl](http://www.itb.pl)



## European Technical Assessment

**ETA-20/0675  
of 18/08/2020**

### General Part

**Technical Assessment Body issuing the European Technical Assessment**

Instytut Techniki Budowlanej

**Trade name of the construction product**

TT Throughbolt

**Product family to which the construction product belongs**

Torque controlled expansion anchor of sizes M8, M10, M12, M16 and M20 for use in uncracked concrete

**Manufacturer**

TRUTEK Fasteners Polska Sp. z o.o.  
Al. Krakowska 38, Janki  
05-090 Raszyn  
Poland  
e-mail: [info@trutek.com.pl](mailto:info@trutek.com.pl)  
[www.trutek.com.pl](http://www.trutek.com.pl)

**Manufacturing plant**

Plant no. 6

**This European Technical Assessment contains**

12 pages including 3 Annexes which form an integral part of this Assessment

**This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of**

European Assessment Document EAD 330232-00-0601 "Mechanical fasteners for use in concrete"

*This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.*

*Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.*

## Specific Part

### 1 Technical description of the product

The TT Throughbolt anchor in the sizes M8, M10, M12, M16 and M20 is made of galvanized steel. The anchor is placed into a drill hole and anchored by torque-controlled expansion.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in Annex C are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Performance of the product

##### 3.1.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic   | Performance |
|--|-------------|
| Characteristic resistance to tension load (static and quasi-static loading), displacements | Annex C1    |
| Characteristic resistance to shear load (static and quasi-static loading), displacements   | Annex C2    |

##### 3.1.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance                               |
|--------------------------|---|
| Reaction to fire         | Anchors satisfy requirements for Class A1 |
| Resistance to fire       | No performance assessed                   |

#### 3.2 Methods used for the assessment

The assessment of the products has been made in accordance with the European Assessment Document EAD 330232-00-0601 "Mechanical fasteners for use in concrete".

### 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision 96/582/EC of the European Commission the system 1 of assessment and verification of constancy of performance applies (see Annex V to Regulation (EU) No 305/2011).

### 5 Technical details necessary for the implementation of the AVCP system, as provided in the applicable European Assessment Document (EAD)

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited in Instytut Techniki Budowlanej.


For type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 18/08/2020 by Instytut Techniki Budowlanej



Anna Panek, MSc  
Deputy Director of ITB



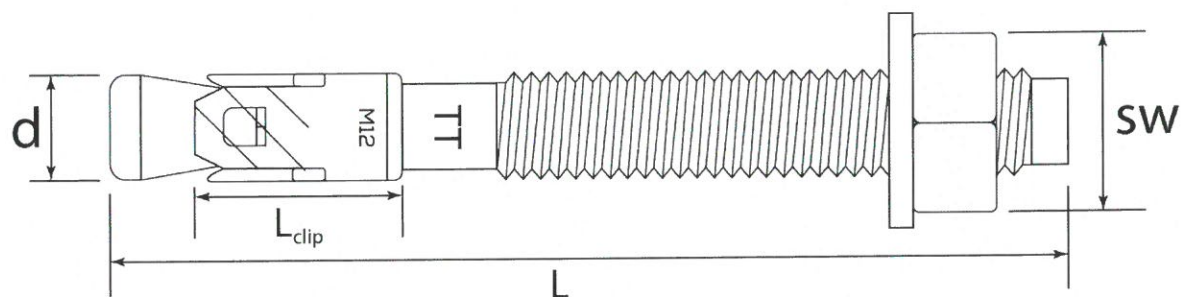

**Table A1: TT Throughbolt anchor dimensions**


| Type of anchor |         |  |  | d<br>[mm] | L<br>[mm] | L <sub>clip</sub><br>[mm] | SW<br>[mm] |
|----------------|---------|--|--|-----------|-----------|---------------------------|------------|
| Size           | Marking | t <sub>fix,STD</sub> <sup>1)</sup><br>[mm] | t <sub>fix,RED</sub> <sup>2)</sup><br>[mm] |           |           |                           |            |
| M8             | TT08    | 1 – 135                                    | 1 – 145                                    | 8         | 55 – 200  | 15,3                      | 13         |
| M10            | TT10    | 1 – 145                                    | 1 – 155                                    | 10        | 65 – 220  | 17,9                      | 17         |
| M12            | TT12    | 1 – 180                                    | 1 – 200                                    | 12        | 80 – 280  | 21,3                      | 19         |
| M16            | TT16    | 1 – 175                                    | 1 – 195                                    | 16        | 105 – 300 | 24,4                      | 24         |
| M20            | TT20    | 1 – 155                                    | 5 – 175                                    | 20        | 130 – 300 | 28,6                      | 30         |

<sup>1)</sup> thickness of the fixed element for standard effective anchorage depth  
<sup>2)</sup> thickness of the fixed element for reduced effective anchorage depth

**Marking:**

Marking on the bolt: “TT”

|  |   |
|--|---|
| <b>TT Throughbolt</b>                                | <b>Annex A1</b><br>of European<br>Technical Assessment<br>ETA-20/0675 |
| <b>Product description</b><br>Dimensions and marking |   |

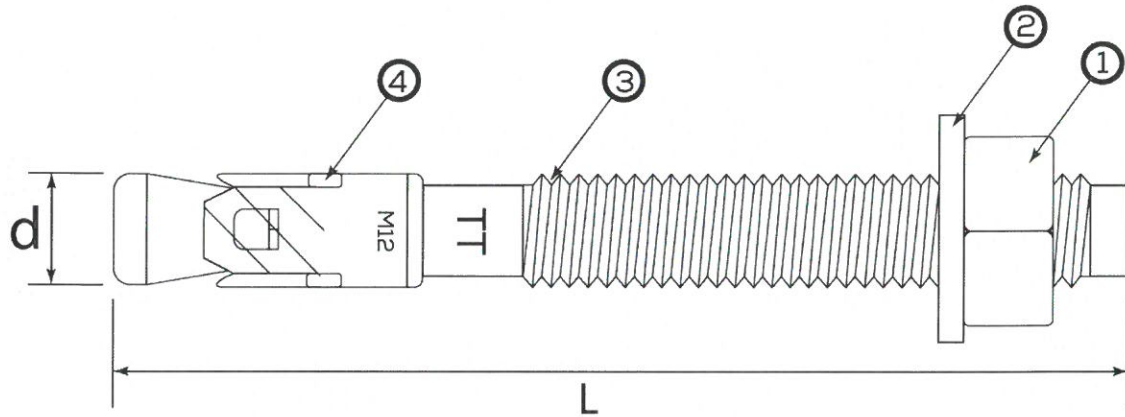

**Table A2: Materials**

| Part | Designation      | Material  | Coating   |
|------|------------------|---|---|
| 1    | Hexagon nut      | EN ISO 898-2 carbon steel class 8 / DIN 934 / AISI 1008                                     | Zinc plated $\geq 5 \mu\text{m}$<br>EN ISO 4042 |
| 2    | Washer           | DIN 125 or<br>EN ISO 7089   |   |
| 3    | Bolt             | Q195<br>Cold-formed steel<br>$f_{uk} \geq 400 \text{ MPa}$<br>$f_{yk} \geq 320 \text{ MPa}$ |   |
| 4    | Expansion sleeve |   |   |

|   |   |
|---|---|
| <b>TT Throughbolt</b>                   | <b>Annex A2</b><br>of European<br>Technical Assessment<br>ETA-20/0675 |
| <b>Product description</b><br>Materials |   |

**Specification of intended use**

**Anchorage subject to:**

- Static and quasi-static loads.

**Base material:**

- Reinforced or unreinforced normal weight concrete of strength classes C20/25 at minimum and C50/60 at maximum according to EN 206.
- Uncracked concrete.

**Use conditions (environmental conditions):**

- Structures subject to dry internal conditions.


**Design:**

- The anchorages under static loads and quasi-static loads are designed in accordance with EN 1992-4:2018 and EOTA Technical Report TR 055, under the responsibility of an engineer experienced in anchorages and concrete work.
- The position of the anchor is indicated on the design drawings.
- Verifiable calculation notes and drawings are taking account of the loads to be transmitted.

**Installation of anchors:**

- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Use of the anchor only as supplied by the manufacturer without exchanging any component of the anchor.
- Anchor installation in accordance with the manufacturer's specification and drawings and using the appropriate tools.
- Checks before placing the anchor to ensure that the strength class of the concrete in which the anchor is to be placed is in the range given and is not lower than that of the concrete to which the characteristic loads apply.
- Check of concrete being well compacted, e.g. without significant voids.
- Effective anchorage depth, edge distances and spacings not less than the specified values without minus tolerances.
- Positioning of the drill holes without damaging the reinforcement.
- Hole drilling by hammer drill.
- Cleaning of the hole of drilling dust.
- Application of the torque moment using a calibrated torque wrench.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application.

|                                       |   |
|---------------------------------------|---|
| <b>TT Throughbolt</b>                 | <b>Annex B1</b><br>of European<br>Technical Assessment<br>ETA-20/0675 |
| <b>Intended use</b><br>Specifications |   |

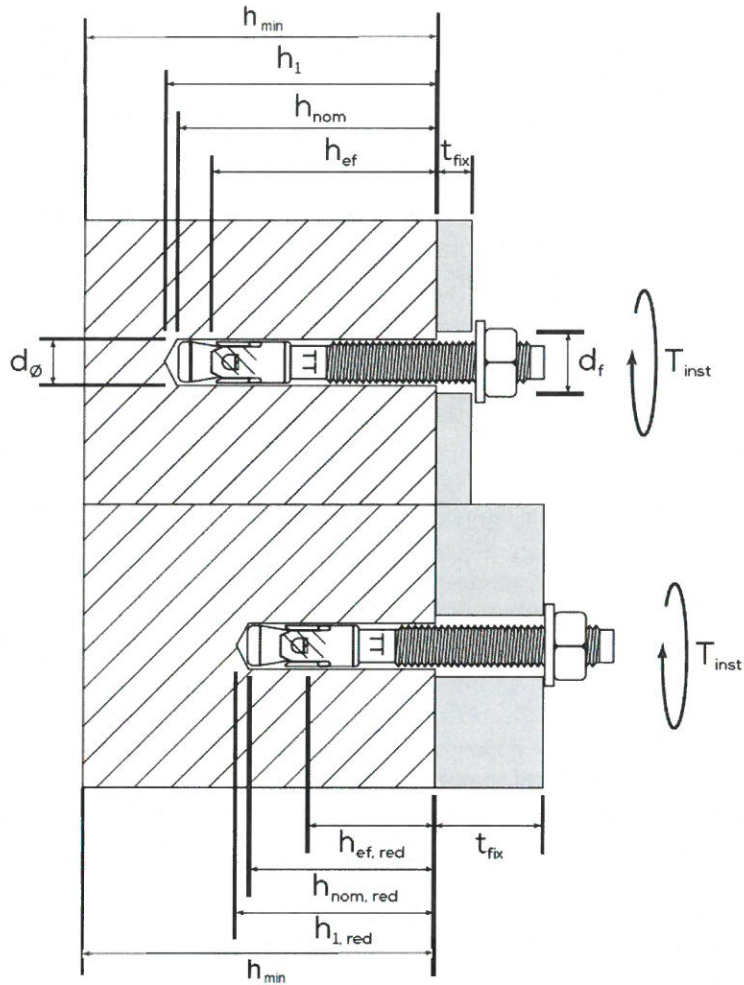


**Table B1: Installation parameters**

| Anchor size                               |                        | M8  | M10 | M12 | M16 | M20 |
|---|------------------------|-----|-----|-----|-----|-----|
| Effective anchorage depth (standard)      | $h_{ef,STD} = [mm]$    | 45  | 50  | 70  | 85  | 100 |
| Effective anchorage depth (reduced)       | $h_{ef,RED} = [mm]$    | 35  | 40  | 50  | 65  | 80  |
| Nominal drill hole diameter               | $d_o = d_{cut} = [mm]$ | 8   | 10  | 12  | 16  | 20  |
| Depth of drill hole (standard)            | $h_{0,STD} \geq [mm]$  | 53  | 58  | 80  | 99  | 110 |
| Depth of drill hole (reduced)             | $h_{0,RED} \geq [mm]$  | 43  | 48  | 60  | 70  | 90  |
| Diameter of clearance hole in the fixture | $d_f \leq [mm]$        | 9   | 12  | 14  | 18  | 22  |
| Installation torque                       | $T_{inst} = [Nm]$      | 25  | 35  | 60  | 120 | 200 |
| Minimum thickness of member               | $h_{min} = [mm]$       | 100 | 100 | 140 | 170 | 200 |
| Minimum spacing                           | $s_{min} = [mm]$       | 35  | 40  | 50  | 65  | 80  |
| Minimum edge distance                     | $c_{min} = [mm]$       | 35  | 40  | 50  | 65  | 80  |

|  |   |
|--|---|
| <b>TT Throughbolt</b>                          | <b>Annex B2</b><br>of European<br>Technical Assessment<br>ETA-20/0675 |
| <b>Intended use</b><br>Installation parameters |   |



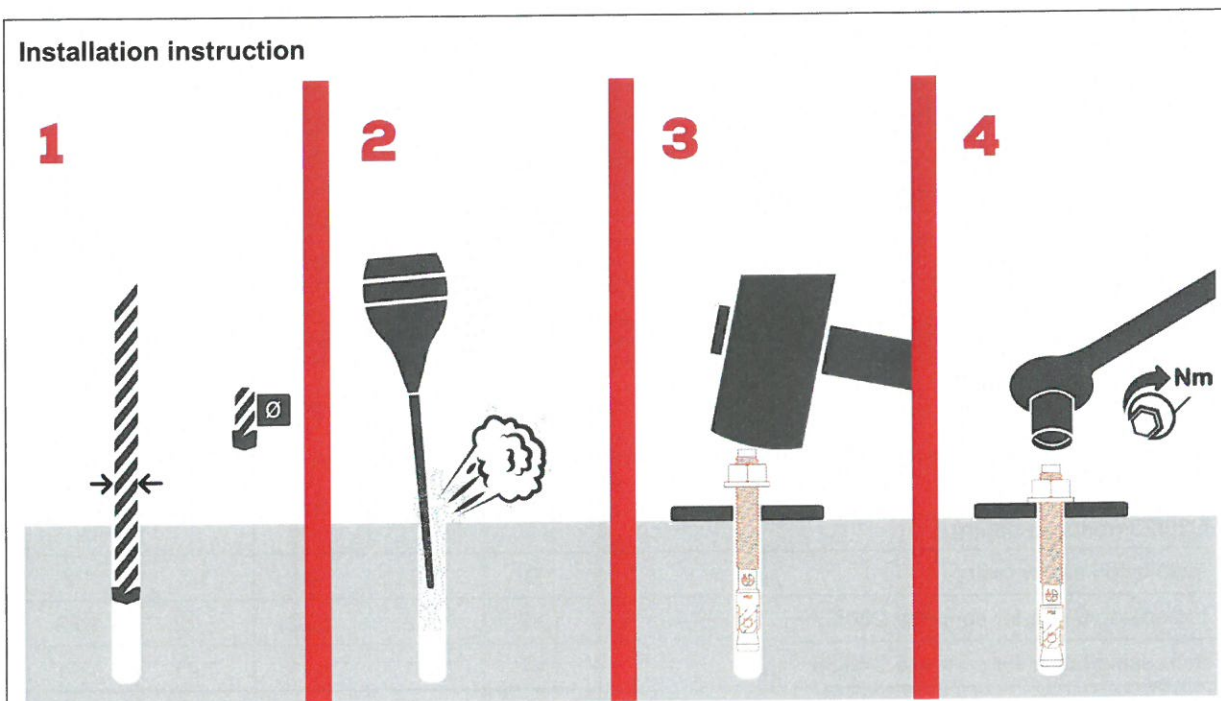

|   |   |
|---|---|
| <p><b>TT Throughbolt</b></p>                            | <p><b>Annex B3</b><br/>of European<br/>Technical Assessment<br/>ETA-20/0675</p> |
| <p><b>Intended use</b><br/>Installation instruction</p> |   |

**Table C1: Design method A, characteristic values for tension loads**

| Anchor size  |                              | M8      | M10  | M12  | M16   | M20  |
|--|------------------------------|---------|------|------|-------|------|
| <b>Steel failure</b>   |                              |         |      |      |       |      |
| Characteristic resistance  | $N_{Rk,s}$ [kN]              | 14,6    | 23,2 | 33,7 | 62,8  | 98,0 |
| Modulus of elasticity  | $E_s$ [N/mm <sup>2</sup> ]   | 210 000 |      |      |       |      |
| Partial safety factor  | $\gamma_{Ms}^{1)}$           | 1,5     |      |      |       |      |
| <b>Pull-out failure</b>  |                              |         |      |      |       |      |
| Characteristic resistance in uncracked concrete C20/25 (standard depth)  | $N_{Rk,p,STD}$ [kN]          | 9,5     | 11   | 20   | 26    | 48   |
| Characteristic resistance in uncracked concrete C20/25 (reduced depth)   | $N_{Rk,p,RED}$ [kN]          | 9,5     | 9,5  | 12   | 24    | 34   |
| Installation safety factor   | $\gamma_{inst}^{2)}$         | 1,0     | 1,0  | 1,0  | 1,2   | 1,2  |
| Increasing factor for concrete C30/37  | $\psi_c$                     | 1,22    | 1,22 | 1,22 | 1,22  | 1,22 |
| Increasing factor for concrete C40/50  |                              | 1,41    | 1,41 | 1,41 | 1,41  | 1,41 |
| Increasing factor for concrete C50/60  |                              | 1,55    | 1,55 | 1,55 | 1,55  | 1,55 |
| <b>Concrete cone failure and splitting failure</b>   |                              |         |      |      |       |      |
| Effective anchorage depth (standard)   | $h_{ef,STD}$ [mm]            | 45      | 50   | 70   | 85    | 100  |
| Effective anchorage depth (reduced)  | $h_{ef,RED}$ [mm]            | 35      | 40   | 50   | 65    | 80   |
| Factor for uncracked concrete  | $k_1^{2)}) = k_{Ucr,N}^{2)}$ | 11,0    | 11,0 | 11,0 | 11,0  | 11,0 |
| Spacing (standard depth)   | $s_{cr,N,STD}$ [mm]          | 135     | 150  | 210  | 255   | 300  |
| Edge distance (standard depth)   | $c_{cr,N,STD}$ [mm]          | 67,5    | 75   | 105  | 127,5 | 150  |
| Spacing (reduced depth)  | $s_{cr,N,RED}$ [mm]          | 105     | 120  | 150  | 195   | 240  |
| Edge distance (reduced depth)  | $c_{cr,N,RED}$ [mm]          | 52,5    | 60   | 75   | 97,5  | 120  |
| Characteristic resistance for splitting (standard depth)   | $N^0_{Rk,sp,STD}^{2)}$ [kN]  | 9,5     | 11   | 20   | 26    | 48   |
| Characteristic resistance for splitting (reduced depth)  | $N^0_{Rk,sp,RED}^{2)}$ [kN]  | 9,5     | 9,5  | 12   | 24    | 34   |
| Spacing (standard depth)   | $s_{cr,sp,STD}$ [mm]         | 135     | 150  | 210  | 255   | 300  |
| Edge distance (standard depth)   | $c_{cr,sp,STD}$ [mm]         | 67,5    | 75   | 105  | 127,5 | 150  |
| Spacing (reduced depth)  | $s_{cr,sp,RED}$ [mm]         | 105     | 120  | 150  | 195   | 240  |
| Edge distance (reduced depth)  | $c_{cr,sp,RED}$ [mm]         | 52,5    | 60   | 75   | 97,5  | 120  |
| Installation safety factor   | $\gamma_{inst}^{2)}$         | 1,0     | 1,0  | 1,0  | 1,2   | 1,2  |
| <sup>1)</sup> in the absence of other national regulations<br><sup>2)</sup> parameter for design according to EN 1992-4:2018 |                              |         |      |      |       |      |

TT Throughbolt

Performances

Design method A, characteristic values for tension loads, displacements

Annex C1

of European  
Technical Assessment  
ETA-20/0675

**Table C2: Displacements under tension loads**

| Anchor size  |                         | M8  | M10  | M12 | M16  | M20  |
|--------------|-------------------------|-----|------|-----|------|------|
| Tension load | N [kN]                  | 4,5 | 4,6  | 6,1 | 10,8 | 14,8 |
| Displacement | $\delta_{N0}$ [mm]      | 2,0 | 1,00 | 1,6 | 1,0  | 0,4  |
|              | $\delta_{N\infty}$ [mm] | 0,6 | 0,6  | 0,6 | 0,6  | 0,6  |

**TT Throughbolt**

**Performances**

Design method A, characteristic values for tension loads, displacements

**Annex C1**

of European  
Technical Assessment  
ETA-20/0675



**Table C3: Design method A, characteristic values for shear loads**

| Anchor size  |                        | M8   | M10  | M12  | M16   | M20   |
|--|------------------------|------|------|------|-------|-------|
| <b>Steel failure without lever arm</b>   |                        |      |      |      |       |       |
| Characteristic resistance  | $V_{Rk,s}^{0,2)}$ [kN] | 7,3  | 11,6 | 16,9 | 31,4  | 49,0  |
| Ductility factor   | $k_7^{2)}$             | 0,8  | 0,8  | 0,8  | 0,8   | 0,8   |
| Partial safety factor  | $\gamma_{Ms}^{1)}$     | 1,25 | 1,25 | 1,25 | 1,25  | 1,25  |
| <b>Steel failure with lever arm</b>  |                        |      |      |      |       |       |
| Characteristic bending resistance  | $M_{Rk,s}^0$ [Nm]      | 15,0 | 29,9 | 52,4 | 133,2 | 259,6 |
| Partial safety factor  | $\gamma_{Ms}^{1)}$     | 1,25 | 1,25 | 1,25 | 1,25  | 1,25  |
| <b>Concrete pry-out failure</b>  |                        |      |      |      |       |       |
| Concrete pry-out failure factor  | $k_8^{2)}$             | 1,0  | 1,0  | 2,0  | 2,0   | 2,0   |
| Partial safety factor  | $\gamma_{Mc}^{1)}$     | 1,5  | 1,5  | 1,5  | 1,8   | 1,8   |
| <b>Concrete edge failure</b>   |                        |      |      |      |       |       |
| Effective length of anchor under shear loading (standard depth)  | $l_{i,STD}$ [mm]       | 45   | 50   | 70   | 85    | 100   |
| Effective length of anchor under shear loading (reduced depth)   | $l_{i,RED}$ [mm]       | 35   | 40   | 50   | 65    | 80    |
| Effective diameter of anchor   | $d_{nom}$ [mm]         | 8    | 10   | 12   | 16    | 20    |
| Partial safety factor  | $\gamma_{Mc}^{1)}$     | 1,5  | 1,5  | 1,5  | 1,8   | 1,8   |
| <sup>1)</sup> in the absence of other national regulations<br><sup>2)</sup> parameter for design according to EN 1992-4:2018 |                        |      |      |      |       |       |

**Table C4: Displacements under shear loads**

| Anchor size  |                         | M8  | M10 | M12 | M16  | M20  |
|--------------|-------------------------|-----|-----|-----|------|------|
| Shear load   | $V$ [kN]                | 4,2 | 6,6 | 9,7 | 18,0 | 28,0 |
| Displacement | $\delta_{v0}$ [mm]      | 1,4 | 1,3 | 1,2 | 2,1  | 1,5  |
|              | $\delta_{v\infty}$ [mm] | 2,1 | 1,9 | 1,8 | 3,2  | 2,3  |

TT Throughbolt

**Performances**

Design method A, characteristic values for shear loads, displacements

**Annex C2**  
of European  
Technical Assessment  
ETA-20/0675