

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

ETA-19/0774  
of 28 January 2020

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

TAB HE Concrete Screw

Product family  
to which the construction product belongs

Mechanical fastener for use in concrete

Manufacturer

TRUTEK Fasteners Polska Sp z o.o  
Al. Krakowski 38, Janki  
05-090 RASZYN  
POLEN

Manufacturing plant

Trutek Plant No. 5

This European Technical Assessment  
contains

15 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330232-00-0601

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The TAB HE Concrete Screw is an anchor made of galvanised steel of sizes 8, 10, 12, 14 and 16. The anchor is screwed into a predrilled cylindrical drill hole. The special thread of the anchor cuts an internal thread into the member while setting. The anchorage is characterised by mechanical interlock in the special thread.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex C 1 and C 2
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 3
Displacements (static and quasi-static loading)	See Annex C 6
Characteristic resistance and displacements for seismic performance categories C1 and C2	No performance assessed
Durability	See Annex B 1

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 4 and C 5

### 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330232-00-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 28 January 2020 by Deutsches Institut für Bautechnik

BD Dipl.-Ing. Andreas Kummerow  
Head of Department


*beglaubigt:*  
Baderschneider

## TAB HE Concrete Screw:

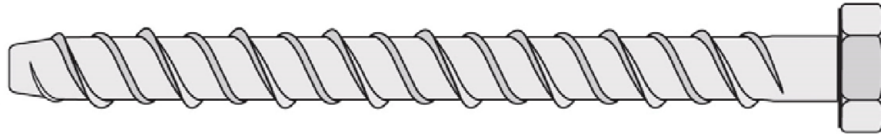

### Intended use


Concrete strength classes C20/25 to C50/60

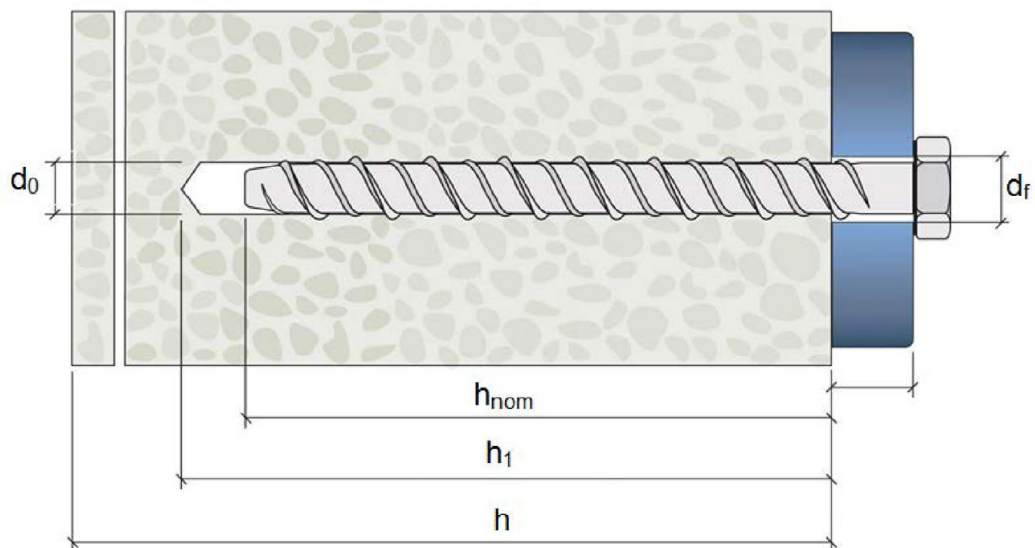

**TAB HE Concrete Screw**

**Product description**  
Product and intended use

**Annex A1**

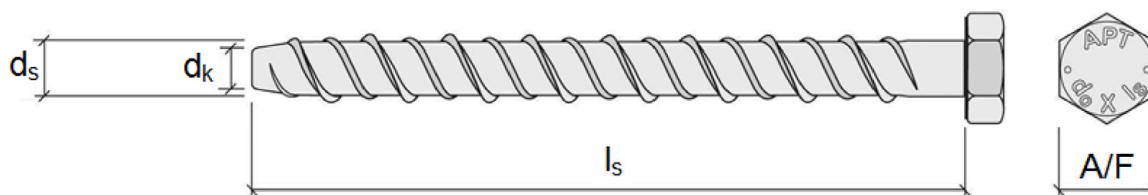

### Marking

- Identifying mark of producer
- Nominal drill hole diameter
- Nominal anchor length

**Table A1: Materials**

Designation	Material
Concrete Screw	Carbon steel, heat treated and zinc plated

**Table A2: Dimensions**

Anchor size			8	10	12	14	16
Nominal anchor length	$l_s$	[mm]	80...150	100...150	100...200	130...200	150...200
Outside diameter of thread	$d_s$	[mm]	9,8	11,9	14,1	16,3	18,7
Core diameter	$d_k$	[mm]	7,5	9,5	11,4	13,4	15,3
Width across flats	A/F	[mm]	15	17	19	24	27

**TAB HE Concrete Screw**

**Product description**

Designation of anchor parts, materials and dimensions

**Annex A2**

## Specifications of intended use

### Anchorage subject to:

- Static and quasi-static loads: all sizes.
- Fire exposure: all sizes.

### Base materials:

- Reinforced or unreinforced normal weight concrete according to EN 206:2013.
- Strength classes C20/25 to C50/60 according to EN 206:2013.
- Non-cracked concrete and cracked concrete: all sizes.

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions.

### Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed in accordance with EN 1992-4:2018 and Technical Report TR 055, February 2018.

### Installation:

- Hole drilling by rotary hammer drilling mode: all sizes.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of the load application.
- After installation further turning of the anchor must not be possible.
- The head of the anchor must be supported on the fixture and is not damaged.

**TAB HE Concrete Screw**

**Intended Use**  
Specifications

**Annex B1**

**Table B1: Installation parameters**

Anchor size			8	10	12	14	16
Overall anchor embedment depth	$h_{nom}$	[mm]	75	85	95	110	120
Effective anchorage depth	$h_{ef}$	[mm]	55	62	69	79	86
Nominal drill hole diameter	$d_0$	[mm]	8	10	12	14	16
Drill hole depth	$h_0$	[mm]	90	100	110	130	145
Outside diameter of the anchor	$d_{nom}$	[mm]	10	12	14	16	18
Clearance hole in the fixture	$d_f$	[mm]	12	14	16	18	20
Setting torque	$T_{inst}$	[Nm]	40	60	80	90	100

**Table B2: Minimum thickness of concrete member, minimum spacing and edge distance**

Anchor size			8	10	12	14	16
Minimum thickness of concrete member	$h_{min}$	[mm]	120	125	140	170	190
Minimum spacing	$s_{min}$	[mm]	50	60	70	80	90
Minimum edge distance	$c_{min}$	[mm]	50	60	70	80	90

In case of fire attack from more than one side:  $c_{min} \geq 300$  mm

**TAB HE Concrete Screw**


**Intended Use**

Installation parameters, minimum thickness of concrete member, minimum spacing and edge distance

**Annex B2**



## Installation instructions

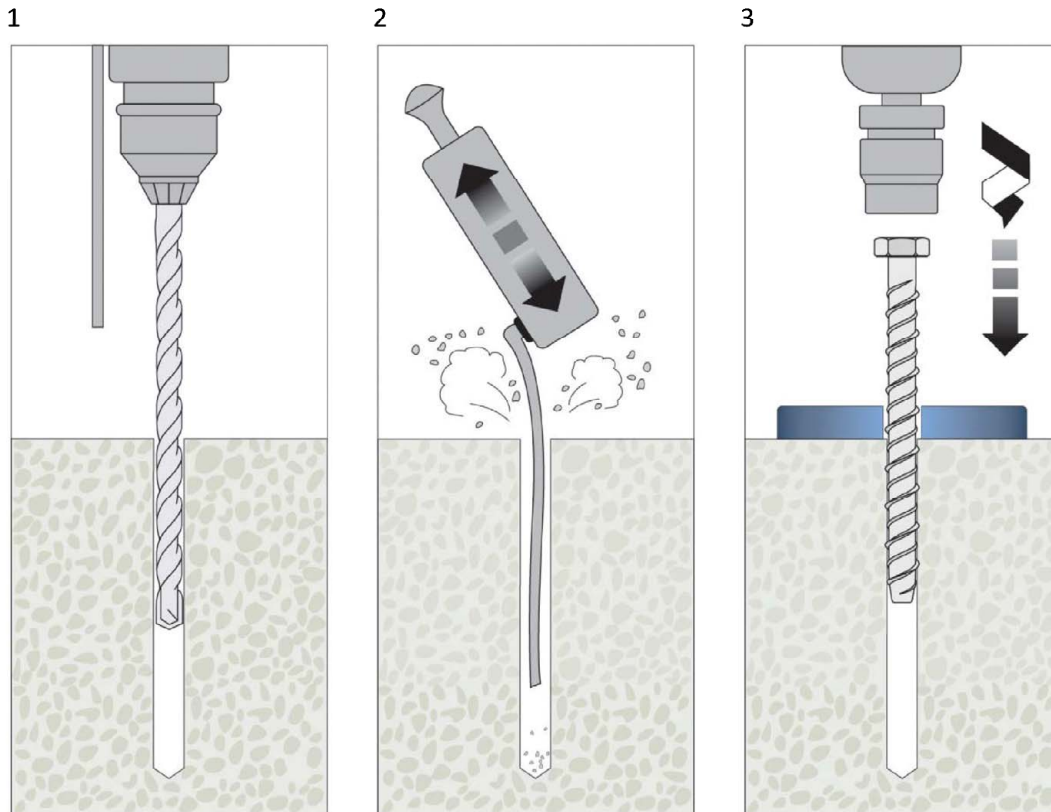

1. Drill hole to correct diameter and depth using rotary hammer drilling machine
2. Remove dust from hole by blowing 3 times
3. Install anchor using electrical impact screwdriver Bosch GDS18E or Makita 6905H.  
Other electrical screwdrivers of equivalent force and performance may be used.

**TAB HE Concrete Screw**

**Intended Use**  
Installation instructions

**Annex B3**

**Table C1: Characteristic values of resistance under tension loads in non-cracked concrete**

Anchor size			8	10	12	14	16
Installation factor	$\gamma_{inst}$	[-]	1,2				
<b>Steel failure</b>							
Characteristic resistance	$N_{Rk,s}$	[kN]	44,2	70,1	101,2	140,0	183,9
Partial factor	$\gamma_{MS}^{1)}$	[-]	1,4				
<b>Pullout failure</b>							
Characteristic resistance	$N_{Rk,p}$	[kN]	12	16	20	35	40
Increasing factor for $N_{Rk,p}$	$\Psi_C$	C30/37	1,17			1,22	
		C40/50	1,32			1,41	
		C50/60	1,42			1,55	
Factor for uncracked concrete	$k_{ucr}$	[-]	11,0				
<b>Concrete cone failure</b>							
Effective anchoring depth	$h_{ef}$	[mm]	55	62	69	79	86
Spacing	$s_{cr,N}$	[mm]	$3 h_{ef}$				
Edge distance	$c_{cr,N}$	[mm]	$1,5 h_{ef}$				
<b>Splitting failure</b>							
Spacing	$s_{cr,sp}$	[mm]	176	190	214	250	260
Edge distance	$c_{cr,sp}$	[mm]	88	95	107	125	130

<sup>1)</sup> In absence of other national regulations.

**TAB HE Concrete Screw**

**Performances**

Characteristic values of resistance under tension loads in non-cracked concrete

**Annex C1**

**Table C2: Characteristic values of resistance under tension loads in cracked concrete**

Anchor size			8	10	12	14	16
Installation factor	$\gamma_{inst}$	[-]	1,2				
<b>Steel failure</b>							
Characteristic resistance	$N_{Rk,s}$	[kN]	44,2	70,1	101,2	140,0	183,9
Partial factor	$\gamma_{MS}^{1)}$	[-]	1,4				
<b>Pullout failure</b>							
Characteristic resistance	$N_{Rk,p}$	[kN]	7,5	12	16	20	25
Increasing factor for $N_{Rk,p}$		C30/37	1,17			1,22	
		C40/50	1,32			1,41	
		C50/60	1,42			1,55	
Factor for cracked concrete	$k_{cr}$	[-]	7,7				
<b>Concrete cone failure</b>							
Effective anchoring depth	$h_{ef}$	[mm]	55	62	69	79	86
Spacing	$s_{cr,N}$	[mm]	$3 h_{ef}$				
Edge distance	$c_{cr,N}$	[mm]	$1,5 h_{ef}$				
<b>Splitting failure</b>							
Spacing	$s_{cr,sp}$	[mm]	176	190	214	250	260
Edge distance	$c_{cr,sp}$	[mm]	88	95	107	125	130

<sup>1)</sup> In absence of other national regulations.

**TAB HE Concrete Screw**

**Performances**

Characteristic values of resistance under tension loads in cracked concrete

**Annex C2**

**Table C3: Characteristic values of resistance under shear loads in cracked or non-cracked concrete**

Anchor size			8	10	12	14	16
<b>Steel failure without level arm</b>							
Characteristic resistance	$V_{Rk,s}$	[kN]	28,5	46,4	57,2	80,4	84,4
Ductility factor	$k_7$	[-]	0,8				
Partial factor	$\gamma_{MS}^{1)}$	[-]	1,5				
<b>Steel failure with level arm</b>							
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	40	80	138	224	338
Partial safety factor	$\gamma_{MS}^{1)}$	[-]	1,5				
<b>Concrete pry out failure</b>							
k-Factor	$k_8$	[mm]	1,0	2,0			
<b>Concrete edge failure</b>							
Effective length of anchor in shear loading	$l_f$	[mm]	55	62	69	79	86
Effective external diameter of anchor	$d_{nom}$	[mm]	10	12	14	16	18

<sup>1)</sup> In absence of other national regulations.

**TAB HE Concrete Screw**

**Performances**

Characteristic values of resistance under shear loads in cracked or non-cracked concrete

**Annex C3**

**Table C4: Characteristic values for tension load under fire exposure in cracked or non-cracked concrete C20/25 to C50/60**

Anchor size				8	10	12	14	16
<b>Steel failure</b>								
Characteristic resistance	R30	$N_{Rk,s,fi}$	[kN]	0,4	1,1	2,0	2,8	3,7
	R60	$N_{Rk,s,fi}$	[kN]	0,4	0,9	1,5	2,1	2,8
	R90	$N_{Rk,s,fi}$	[kN]	0,3	0,7	1,3	1,8	2,4
	R120	$N_{Rk,s,fi}$	[kN]	0,2	0,6	1,0	1,4	1,8
<b>Pullout failure</b>								
Characteristic resistance	R30	$N_{Rk,p,fi}$	[kN]	1,9	3,0	4,0	5,0	6,3
	R60							
Characteristic resistance	R90	$N_{Rk,p,fi}$	[kN]	1,5	2,4	3,2	4,0	5,0
	R120							
<b>Concrete cone failure</b>								
Characteristic resistance	R30	$N^0_{Rk,c,fi}$	[kN]	4,0	5,4	7,1	10,0	12,3
	R60							
Characteristic resistance	R90	$N^0_{Rk,c,fi}$	[kN]	3,2	4,4	5,7	8,0	9,9
	R120							
Characteristic spacing	$s_{cr,N}$	[mm]	4 x $h_{ef}$					
Edge distance	$c_{cr,N}$	[mm]	2 x $h_{ef}$					

**TAB HE Concrete Screw**

**Performances**

Characteristic values for tension load under fire exposure in cracked and non-cracked concrete C20/25 to C50/60

**Annex C4**

**Table C5: Characteristic values for shear load under fire exposure in cracked or non-cracked concrete C20/25 to C50/60**

Anchor size				8	10	12	14	16
<b>Steel failure without level arm</b>								
Characteristic resistance	R30	$V_{Rk,s,fi}$	[kN]	0,4	1,1	2,0	2,8	3,7
	R60	$V_{Rk,s,fi}$	[kN]	0,4	0,9	1,5	2,1	2,8
	R90	$V_{Rk,s,fi}$	[kN]	0,3	0,7	1,3	1,8	2,4
	R120	$V_{Rk,s,fi}$	[kN]	0,2	0,6	1,0	1,4	1,8
<b>Steel failure with level arm</b>								
Characteristic resistance	R30	$M_{Rk,s,fi}^0$	[Nm]	0,5	1,5	3,4	5,6	8,4
	R60	$M_{Rk,s,fi}^0$	[Nm]	0,4	1,3	2,6	4,2	6,3
	R90	$M_{Rk,s,fi}^0$	[Nm]	0,3	1,0	2,2	3,6	5,5
	R120	$M_{Rk,s,fi}^0$	[Nm]	0,2	0,8	1,7	2,8	4,2
<b>Concrete pryout failure</b>								
k-Factor	$k_g$	[-]	1,0	2,0				
Characteristic resistance	R30	$V_{Rk,cp,fi}$	[kN]	4,0	10,9	14,2	20,0	24,7
	R60							
	R90	$V_{Rk,cp,fi}$	[kN]	3,2	8,7	11,4	16,0	19,8
	R120							
<b>Concrete edge failure</b>								
<p>The initial value <math>V_{Rk,c,fi}^0</math> of the characteristic resistance in concrete C20/25 to C50/60 under fire exposure may be determined by:</p> $V_{Rk,c,fi}^0 = 0,25 \times V_{Rk,c}^0 (\leq R90) \quad V_{Rk,c,fi}^0 = 0,20 \times V_{Rk,c}^0 (\leq R120)$ <p>With <math>V_{Rk,c}^0</math> initial value of the characteristic resistance in cracked concrete C20/25 under normal temperature.</p>								

$V_{Rk,c}^0$  = characteristic resistance for concrete edge failure in cracked concrete C20/C25 under normal temperature calculated acc. to EN 1992-4:2018.

**TAB HE Concrete Screw**

**Performances**

Characteristic values for shear load under fire exposure in cracked or non-cracked concrete C20/25 to C50/60

**Annex C5**

**Table C6: Displacements under tension load**

Anchor size			8	10	12	14	16
Tension load	N	[kN]	4,8	6,3	7,9	13,9	15,9
Displacement	$\delta_{N0}$	[mm]	0,17	0,21	0,23	0,73	0,46
	$\delta_{N\infty}$	[mm]	1,75	1,88	1,82	1,54	0,96

**Table C7: Displacements under shear load**

Anchor size			8	10	12	14	16
Shear load	V	[kN]	11,3	18,4	22,7	31,9	33,5
Displacement	$\delta_{V0}$	[mm]	1,61	1,53	1,94	2,74	2,66
	$\delta_{V\infty}$	[mm]	2,42	2,30	2,92	4,10	3,99

**TAB HE Concrete Screw**

Performances  
Displacements

**Annex C6**